

OFFICE OF THE COLLECTOR & DISTRICT MAGISTRATE: NUAPADA
(ST & SC DEVELOPMENT SECTION)

No. 3045 dt. 21.12.21

Dated.

TENDER CALL NOTICE


Sealed tenders in the prescribed paper are invited from the intending Firms/Suppliers having valid Odisha GST and ISO Certification for supply of RO based drinking water supply systems (RO Plant) in ST & SC Development Department residential schools of Nuapada District during the academic year, 2020-21. The minimum qualifying criteria for the Firms/Suppliers to participate in the tender are given in **Annexure – I**. The specification of each of the components of the RO based drinking water supply system is given in **Annexure – II**. The details of the tender call notice can be downloaded from the District website www.nuapada.nic.in. The tender paper can be obtained from the Office of DWO, Nuapada in any working day during the officials hours on payment of Rs. 10,000/- only or can be downloaded from the District Website. The paper cost and EMD cost is as below;

Name of the work	PAPER COST	EMD COST
RO based drinking water supply system (RO Plant) with 250 LPH and 500 LPH filtering capacity.	Rs. 10,000/-	Rs.2,00,000/-

The bidders who download tender paper online should pay the tender paper cost in shape of DD in favour of DWO, Nuapada. The Sealed quotations should reach to the Office of District Welfare Officer, ST & SC Development Section, Collectorate, Nuapada by **Registered Post or Speed Post only** on or before **10 .01.2022 up to 5.00 P.M** and it will be opened on **12.01.2022 at 11.00 A.M** at Collectorate, Nuapada in presence of the members of the Tender Committee and bidders. No sealed quotation shall be accepted after the due date. The above Tender is subject to the terms & conditions as given in **Annexure – III** of this tender call notice.


The Earnest Money Dues (EMD) and Tender Paper cost as indicated in the above table in item is to be deposited in shape of Bank Draft (SBI Bank, only) drawn in favour of the District Welfare Officer, Nuapada payable at SBI, Nuapada along with Tender documents. While the paper cost is non-refundable, the EMD is refundable. Transfer or adjustment of E.M.D will not be entertained. In case of shortfall of any required documents, Drafts for Tender Paper Cost and EMD, the bid will not be entertained and the same will be liable for rejection. **NO TENDERS WILL BE RECEIVED BY HAND OR BY COURIER SERVICE.** The undersigned will not be responsible for any delay in postal service.

By order of Collector

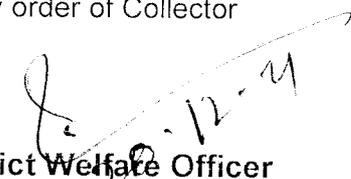
District Welfare Officer
Nuapada

Memo. No. 3046 // SSD, Dt. 21.12.21

Copy along with the sample copy of the above advertisement is forwarded to the Advertising Manager, The Sambad, Sambalpur Edition, Sambalpur, The Samaj, Sambalpur Edition, Sambalpur, Editor Prameya, Bhubaneswar for publication in one Edition for one day only in the size of 8 cm x 10 cm and submit Bill as per Govt. approved rates for sanction/ release of payment.


**District Welfare Officer,
Nuapada**

Memo No. 3047 // SSD, Dt. 21.12.21

Copy to DIO, NIC, Nuapada for information and necessary action. He is requested to upload the details including terms and conditions in the official website of Nuapada District for wide publication.

Copy forwarded to Sub-Collector, Nuapada/ all Block Development Officers/ all Tahasildars/ DI & PRO, Nuapada for information with a request to display the above notice in their Notice Board for wide publication.


**District Welfare Officer,
Nuapada**

ANNEXURE - I

QUALIFYING CRITERIA FOR PARTICIPATING IN THE TENDER

1. Only companies registered with ROC as supplier / manufacturer of RO plants and Department of Industries (NSIC) with valid Odisha GST number and ISO certification are eligible to quote.
2. If the bidder is a dealer, he must furnish the certificate of dealership of RO plant business issued by the manufacturing company.
3. The firm/supplier must be a local GST holder of Odisha . Bidder must have ISO Certification for doing business in supply and installation of RO based drinking water supply systems.
4. The supplier must have experience in supply, delivery, installation and maintenance of minimum 100 Reverse Osmosis Water Treatment Units with a capacity of 250 LPH/ 500 LPH in any State Government Educational Institutions during last three years (i.e., from 2018-19 to 2020-21). The bidder should submit work completion certificate from the appropriate authority in support of his claim of installing the above number of RO plants.
5. The bidders must submit certificate issued by the user Deptt./Govt. Agency regarding his satisfactory annual maintenance of at least 30 RO plants for the last two years.
6. The bidders also must submit separate financial bid (of course in the same cover where the technical and financial bids for the RO plans would be placed) for the cost of AMC (Annual Maintenance Contract) for a single RO plant as specified in the specification sheet.
7. The bidder must furnish VAT clearance certificate valid up to 31.3.2021 and GST return filing up to June 2021.
8. The bidders must submit solvency certificate issued by Bank in respect of his company/ firm at least of Rs. 80 Lakh.
9. The bidder should have an average annual turnover (certified by Auditor) of not less than **Rs.3, 00, 00,000/-** on similar order (supply and installation of RO plants only) in the past three years (i.e., from 2018-19 to 2020-21). Documentary evidence is must.

10. The bidder has to enclose income tax returns including audited balance sheets and computational statements of the last three financial years.
11. The bidder should have in house design & development capability to take care of any modifications required to their products to suit the needs of the Department.
12. The bidder should not have been blacklisted by any State/ Central government and local authorities for breach of contracts in any supplies or work in the past.
13. The bidder should be willing to get the manufacturing facilities inspected by the tender committee to judge the level of competency for undertaking the project.
14. Tenders must be accompanied with earnest money deposit as specified in the tender documents.
15. The Bidder shall have sufficient manufacturing facilities and skilled labour. A proof of available machinery and skilled labour has to be enclosed.
16. The bidders who are registered under NSIC Limited shall have special preference in the selection process per NSIC Rules.


District Welfare Officer
Nuapada

ANNEXURE - III
TERMS & CONDITIONS

1. The bidder should submit technical bid, price bid, and AMC bid in separate forms and on each form the bid type should be clearly super scribed. All these three bids should be again put in a single large envelop before mailing it to the office of DWO, Nuapada.
2. The general scope of this tender includes supply and installation of RO Treatment Plant, storage tank, plant internal plumbing, and plant internal electrification.
3. The supplier shall quote price for RO Treatment Plant which shall include cost of RO Treatment Plant with all accessories, plumbing and electrical work from raw water storage tank and RO plant, plumbing work from RO plant to treated water storage tank and installation of the same.
4. Wherever it is inevitable, the window of the room shall be removed to install treated water storage tank and it shall be re-fixed by the bidder and the cost fixed by Office will reimburse to the bidder. The bidder should not quote any charges for this item in the Financial Bid.
5. The financial bids of only those bidders who technically qualify shall be opened on the day of opening the tender. The price bids of those bidders who do not technically qualify will not be opened at all.
6. The tender committee reserves the right to inspect the factory premises to know the output capacity and quality.
7. The bidder has to sign on all pages of the tender document as having accepted all the terms and conditions of the tender. Tenders, which are not signed on all the pages, will be summarily rejected.
8. The rate must be quoted on comprehensive basis (cost inclusive of all duties, cess and taxes including transportation charges to the destination, which covers all over the district of Nuapada strictly in the format given at Annexure II.
9. Any deviation will be considered as breach of contract and will be dealt accordingly.
10. The authority has every right to reject/accept any/all the tender(s) without assigning any reason.

11. The authority reserves the right to decide the quantity based on the availability of funds.
12. Applications received without complete documents/information shall not be considered.
13. The authority has every right to finalize the tender after negotiations with the lowest bidder regarding prices and other conditions.
14. The defective material/work if found shall be replaced/redone by the supplier free of cost.
15. The supplier has to undertake all repairs, replacements and maintenance during the 12 months period of warranty
16. The work in all respects should be completed within 30 days after receiving the Purchase Order.
17. The Reverse Osmosis Water Treatment Units have to be delivered, and commissioned at various locations of the district.
18. A photograph shall be taken at the time of installation and trial run and shall be enclosed to the invoice for arranging payment.
19. The Bidder should avoid over writings and corrections. However if such corrections and over writings become inescapable, these are to be properly and legibly corrected. Offers with correction/ over writing should be properly attested by the Bidder at every correction.
20. Representatives of Bidder desirous to attend the tender opening, can do so, on production of a proper letter of authority from the respective Bidder, failing which they may not be allowed to attend the tender opening. Authorized representatives of those bidders who have submitted the tender documents alone shall be allowed to attend the tender opening.
21. In all cases of dispute, the decision of the tender committee shall be final.
22. Any dispute or any matter arising out of contract or incidental there to under this enquiry shall be subject to jurisdiction of a competent court of law in Nuapada alone and not in any other place.

23. The authority is not responsible for deduction and payment of taxes to Government. It is the responsibility of the supplier to pay whatever taxes or cess to the appropriate head of account.
24. The paper cost should be submitted for the items for which tender is submitted. The cost of tender paper is not refundable.
25. The tender paper in sealed cover must be accompanied by required EMD in favour of the District Welfare Officer, Nuapada in shape of Bank Draft/Bankers Cheque payable at SBI, Nuapada, which will be refunded immediately to the unsuccessful Tenderers after finalization of Tender and to the Successful Tenderers after full supply of procurement items.
26. The Tender paper is to be addressed to the District Welfare Officer, Nuapada and on the top of the cover should be super scribed "**Tender paper for supply and installation of RO Based Drinking Water Supply System in ST & SC Development Department Residential Schools of Nuapada District in the State of Odisha**".
27. The successful Bidder will have to deposit Security amount 5% of the total cost of articles, in shape of Bank Draft in favour of **District Welfare Officer, Nuapada, payable at SBI, Nuapada.**
28. If the supplier fails to supply the articles with in stipulated period, the order will stand automatically cancelled and the EMD & security money will be forfeited to Government.
29. The successful bidder should replace any damage materials or if arose any incorrect Specification of RO based drinking water supply system (RO Plant) should replace immediately to concerned H.Ms/H.Mrs.
30. During finalization of Tender by Dist. Purchase Committee to place of supply order to lowest Price quoted unit is not mandatory if, pointed out low quality of the system, the committee shall consider the next rate quoted unit observing quality of the Tender sample items.
31. The authority reserves the right to reject any or all Tender without assigning any reasons thereof.


District Welfare Officer
Nuapada

TENDER SCHEDULE FOR SUPPLY AND INSTALLATION RO BASED DRINKING WATER SUPPLY SYSTEM (RO PLANT) FOR SSD RESIDENTIAL SCHOOLS OF NUAPADA DISTRICT FOR THE YEAR, 2021-22

Sl.No	Item	Description of Specification	Rate quoted per Unit (inclusive of all Taxes.)
01	RO based drinking water supply system (RO Plant)		

N.B: Rate quoted should be inclusive of all taxes to School Points.

Signature of the supplier/authorized dealer/

Seal

TENDER SCHEDULE FOR SUPPLY AND INSTALLATION RO BASED
DRINKING WATER SUPPLY SYSTEM (RO PLANT) FOR SSD
RESIDENTIAL SCHOOLS OF NUAPADA DISTRICT FOR THE YEAR,
2021-22

Sl.No	Item	Description	Rate quoted per Unit (inclusive of all Taxes.)
01	Charges for AMC per RO Plant		

N.B: Rate quoted should be inclusive of all taxes to School Points.



Signature of the supplier/authorized dealer/

Seal



ANNEXURE-II

RO PLANT -Equipment Technical Specifications


		250 LPH	500 LPH	1000 LPH
Raw water Pump				
Make	LEO/Equivalent	LEO/Equivalent	LEO/Equivalent	LEO/Equivalent
MOC	Cast Iron	Cast Iron	Cast Iron	Cast Iron
Impeller	Stainless Steel, AISI 304			
Max. Liquid Temp.	80 Degree Cel.	80 degrees cel.	80 degrees cel.	80 degrees cel.
Max. Suction	4 Mtrs.	8 mtrs	8 mtrs	8 mtrs
Type	Mono block	Mono block	Mono block	Mono block
Model	LEO ACM equivalent	LEO ACM 37	LEO ACM 37	LEO ACM 37
Thermal Protector	Built in	Built in	Built in	Built in
Protection Class	IPX4	IPX4	IPX4	IPX4
Discharge	0.5 cum/hr.	1.1 cum/hr	1.1 cum/hr	1.1 cum/hr
Head	2.0 kg/cm2.	2.5 kg/cm2.	2.5 kg/cm2.	2.5 kg/cm2.
Motor	0.37 kw 1 Φ	0.37 kw 1 Φ	0.75 kw 1 Φ	0.75 kw 1 Φ
Motor Winding	Copper	Copper	Copper	Copper
Voltage	200-240 V	200-240 V	200-240 V	200-240 V
frequency	50Hz	50Hz	50Hz	50Hz
Suction / Delivery	19 mm.	25 mm	25 mm	25 mm
Quantity	01 No. (1w)	01 No. (1w)	01 No. (1w)	01 No. (1w)
Pressure sand filter				
Make	Alfa	Alfa	Alfa	Alfa
Type	Down flow	Down flow	Down flow	Down flow
Model	FD 30	FD 50	FD 50	FD 50
Diameter	240 mm	300 mm	300 mm	12"
Height	1370 mm	1200 mm	1200 mm	48"
MOC	FRP	FRP	FRP	FRP
Capacity	1.0 m3/hr.	1.0 m3/hr	1.0 m3/hr	1.0 m3/hr
Filtering media	40 kg 16/32	40 kg 16/32	40 kg 16/32	40 kg 16/32
Type of Media	Graded Pebbles, sand	Graded Pebbles, sand	Graded Pebbles, sand	Graded Pebbles, sand
Valve	20 NB TM MPV F			
Quantity	01 No.	01 No.	01 No.	01 No.

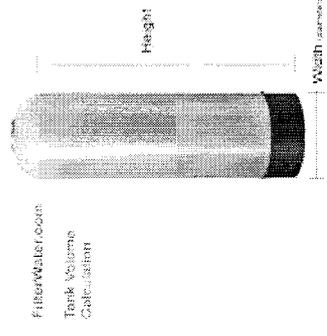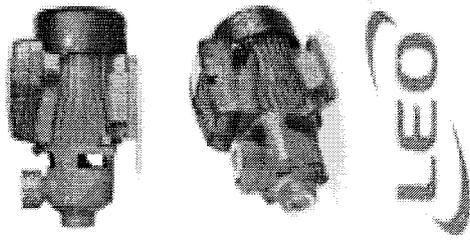

High Pressure Pump		
Make	LEO/Equivalent	LEO/Equivalent
Type	Vertical multistage	Vertical multistage
Model	LEO EVPM 2-9	LEO EVPM 2-9
Discharge	0.6 cum/hr.	1.1 cum/hr
Head	11 kg/cm2.	11 kg/cm2.
Motor	1.5 kw 3 Φ	2.0 kw 1 Φ
Max. Liquid Temp.	80 degrees cel/	80 degrees cel/
Max. Suction	4 mtrs	8 mtrs
Max Discharge	600 mtrs.	1200 mtrs
Max Pressure	8 BAR	12 BAR
Impeller stages	3	6
Motor Winding	Copper	Copper
Thermal Protector	Built in	Built in
Protection Class	IPX4	IPX4
Voltage	200-240 V	200-240 V
frequency	50Hz	50Hz
Suction	19 mm	25 mm
Delivery	19 mm	25 mm
Quantity	01 No. (1w)	01 No. (1w)
Reverse Osmosis System		
Capacity	250 LPH	500 LPH
Module type	Spiral wound	Spiral wound
Membrane specification	TFC Polyamide	TFC Polyamide
Make of membrane	Oltramare/ GE	Oltramare/ GE
No of membrane	1 no	2 nos
No of housing	1 no. (40-250-1)	2 nos. (40-250-1)
Quantity	01 set.	01 set.
Electrical control panel		
Model	GSM based – Real time data transfer to Web, Android App and two mobile phones.	GSM based – Real time data transfer to Web, Android App and two mobile phones.
Type	RO 13 with Conductivity display	RO 13 with Conductivity display

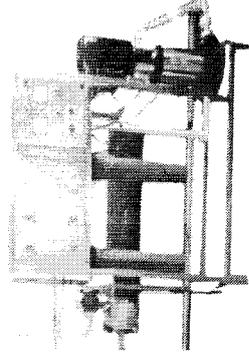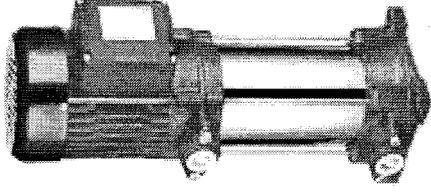

Make Quantity	Wave 01 No. AC Low and High Voltage protection to prevent pumps damage. Low Pressure & High Pressure Switches. TDS & Conductivity display on screen.	Wave 01 No. AC Low and High Voltage protection to prevent pumps damage. Float for Raw Water Tank, Dosing Tank & Treated Water Tank given. Low Pressure & High Pressure Switches. TDS & Conductivity display on screen. LED Indications to show the Power ON, Raw water tank, Auto Flush, HPP, TWT, HPS, LPS & RWP Product design should be as per international safety standards of IEC 60950.	Wave 01 No. AC Low and High Voltage protection to prevent pumps damage. Float for Raw Water Tank, Dosing Tank & Treated Water Tank given. Low Pressure & High Pressure Switches. TDS & Conductivity display on screen. LED Indications to show the Power ON, Raw water tank, Auto Flush, HPP, TWT, HPS, LPS & RWP Product design should be as per international safety standards of IEC 60950.
Description	4 line LCD - to show all plant information on the site. GSM based – Real time data transfer to Web, Android App and two mobile phones. Through App and Mobile phone, RO plant can be controlled for all its functions.	4 line LCD - to show all plant information on the site. GSM based – Real time data transfer to Web, Android App and two mobile phones. Through App and Mobile phone, RO plant can be controlled for all its functions.	4 line LCD - to show all plant information on the site. GSM based – Real time data transfer to Web, Android App and two mobile phones. Through App and Mobile phone, RO plant can be controlled for all its functions.
	If RO plant shutdown, the fault reason will be communicated through SMS to owner for immediate action. Two Flow sensors can be connected; it will show the Treated & Reject water flow in the display.	If RO plant shutdown, the fault reason will be communicated through SMS to owner for immediate action. Two Flow sensors can be connected; it will show the Treated & Reject water flow in the display.	If RO plant shutdown, the fault reason will be communicated through SMS to owner for immediate action. Two Flow sensors can be connected; it will show the Treated & Reject water flow in the display.
	Control Panel shows the RO plant total delivered water Qty from starting to till date.	Control Panel shows the RO plant total delivered water Qty from starting to till date.	Control Panel shows the RO plant total delivered water Qty from starting to till date.

	<p>If any electronic PCB's failed in the control panel, still RO Plant runs in Manual mode.</p> <p>Product design followed as per international safety standards of IEC 60950.</p>	<p>If any electronic PCB's failed in the control panel, still RO Plant runs in Manual mode.</p> <p>Product design followed as per international safety standards of IEC 60950.</p> <p>ISO 9001 certified company with state of the art manufacturing facility.</p>	<p>If any electronic PCB's failed in the control panel, still RO Plant runs in Manual mode.</p> <p>Product design followed as per international safety standards of IEC 60950.</p> <p>ISO 9001 certified company with state of the art manufacturing facility.</p>	
Ultra Violet System Description				
MOC	SS 304	SS 304	SS 304	
Flow rate	500 LPH	500 LPH	1000 LPH	
Power rating	18W	36W	36W	
Power supply	220V	220V	220V	
UV Lamp Intensity	18w	18w	36w	
Burning Hours	8000	8000	8000	
Input water pressure	2kg/cm2	2kg/cm2	2kg/cm2	
Lamp make	Phillips or equivalent	Phillips or equivalent	Phillips or equivalent	
I/O	12.5mm	12.5mm	12.5mm	
Product water tank				
Type	Vertical	Vertical	Vertical	
MOC	SS 304	SS 304	SS 304	
Capacity	500 liters	1000 liters	1000 liters	
Thickness	1mm	1mm	1mm	
I/O	25mm	25mm	25mm	
Mounting	Stand mounted	Stand mounted	Stand mounted	
Raw water tank				
Type	Three Layer	Vertical	Three Layer	
MOC	HDPE	HDPE	HDPE	
Capacity	500 Litres	1000 liters	2000 Litres	
Thickness		Triple layer		
I/O	25 mm	25mm	25mm	
Mounting		Flour mounted		
				
				

Raw water pump	Sand filter	Carbon filter	Micron filters	High pressure pump	Membrane system
To pump the raw water into the system for	Turbidity including mud, sediment, sand etc can be removed by pressure sand filter.	This filter removes Color of water, Smell and Odor and free chlorine in feed water	for filtering the silt and escaped particles to the size up to 5 microns	This pump buildup high-pressures for filtering the dissolved solids minerals from raw water	The semi-permeable membrane separates pure water from concentrated water

